


PVFY-P12,18, P24, P30, P36, P48, P54E00A

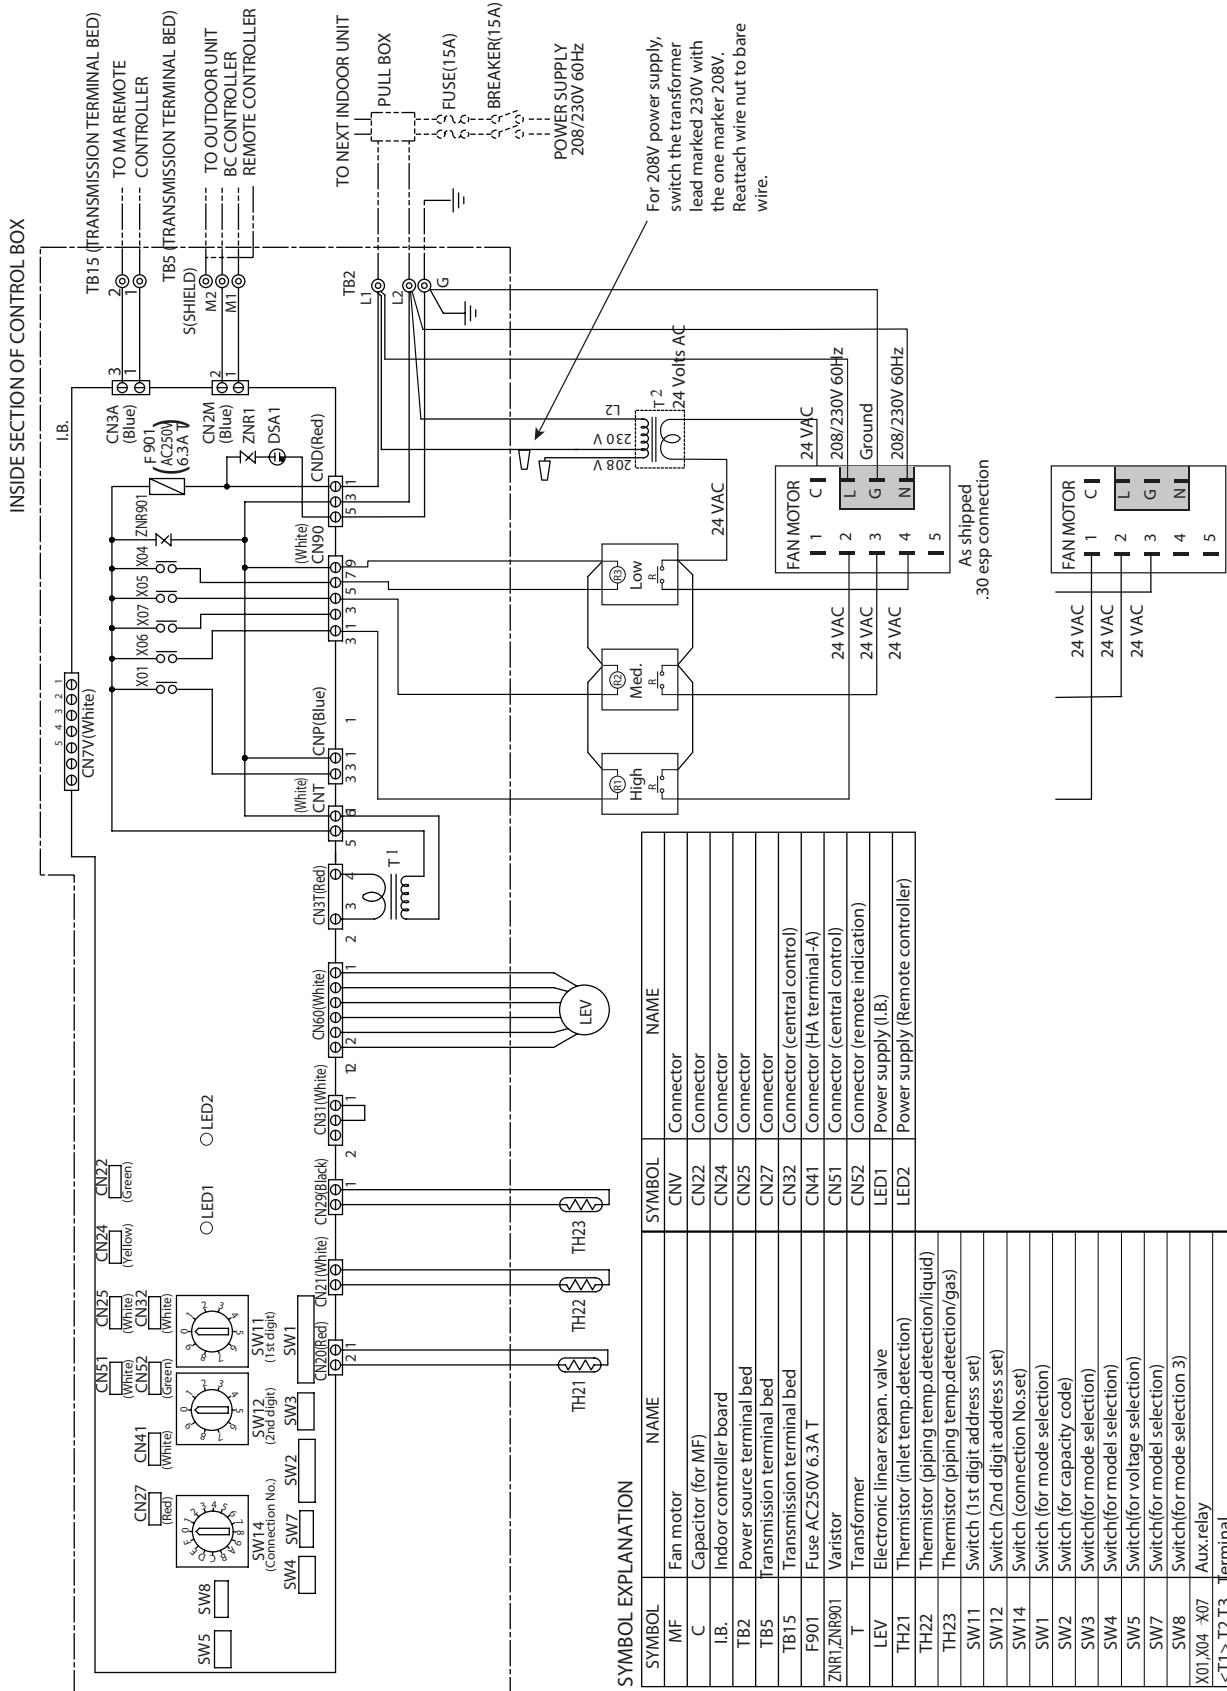

For 208V power supply, switch the transformer lead marked 230V with the one marked 208V. Reattach wire nut to bare wire.

NOTE: 1. The wirings to TB2, TB5, TB15 shown in chained line are field work.
2. Mark @ indicates terminal bed, @ connector, @ insertion connector or fastening connector of control board.

For field selected, .50 esp. change low voltage connections as shown